

Report No.:

Test Time: 2018/8/30 13:41

Luminaire Property

Luminaire Manufacturer:

Luminaire Category: RIBBONLYTE

Luminaire Description: RBS2246.024PH 1FT(320mm)

Luminous Length (mm): 320

Luminous Width (mm): 10

Luminous Height (mm): 1

Voltage: 24.0 V

Current: 0.265 A

Power: 6.35 W

Power Factor: 1.000

Photometric Results

CIE Class: Direct

Measurement Flux: 695.5 lm

Downward Ratio: 99%

Horizontal Diffuse Angle(50%): H115.6

Vertical Diffuse Angle(50%): V115.4

Luminaire Efficacy Rating (LER): 110

Max. Intensity: 235.68 cd

Total Rated Lamp Lumens: 695.5 lm

Efficiency: 100%

Upward Ratio: 1%


Central Intensity: 233.44 cd

Pos of Max. Intensity: H150 V1

Picture Of Luminaire



Luminous Intensity Distribution Curve



Average Diffuse Angle(50%): 115.5° Unit: cd

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0: 1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:


Luminous Intensity Distribution Curve



C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1800B
Distance: 9.028 m
Humidity: 60%
Inspector:

Luminous Intensity Distribution Curve(cd/klm)



C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1800B
Distance: 9.028 m
Humidity: 60%
Inspector:


Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	101	101	101	99
1	108	104	99	95	106	101	97	94	97	94	91	93	90	88	89	87	85	83
2	98	90	83	77	96	88	82	76	84	79	75	81	77	73	78	74	71	69
3	90	79	71	64	87	77	70	63	74	68	62	71	66	61	69	64	60	58
4	82	70	61	54	80	68	60	54	66	59	53	63	57	52	61	56	51	49
5	75	62	53	46	73	61	53	46	59	51	46	57	50	45	55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	45	39	50	44	39	37
7	64	51	42	36	63	50	41	35	48	41	35	47	40	35	45	39	35	33
8	60	46	38	32	58	45	37	32	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	41	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	39	31	26	37	30	26	36	30	25	36	30	25	23

Spacing Criteria (0-180): 1.28

Spacing Criteria (90-270): 1.27

Spacing Criteria (Diagonal): 1.40

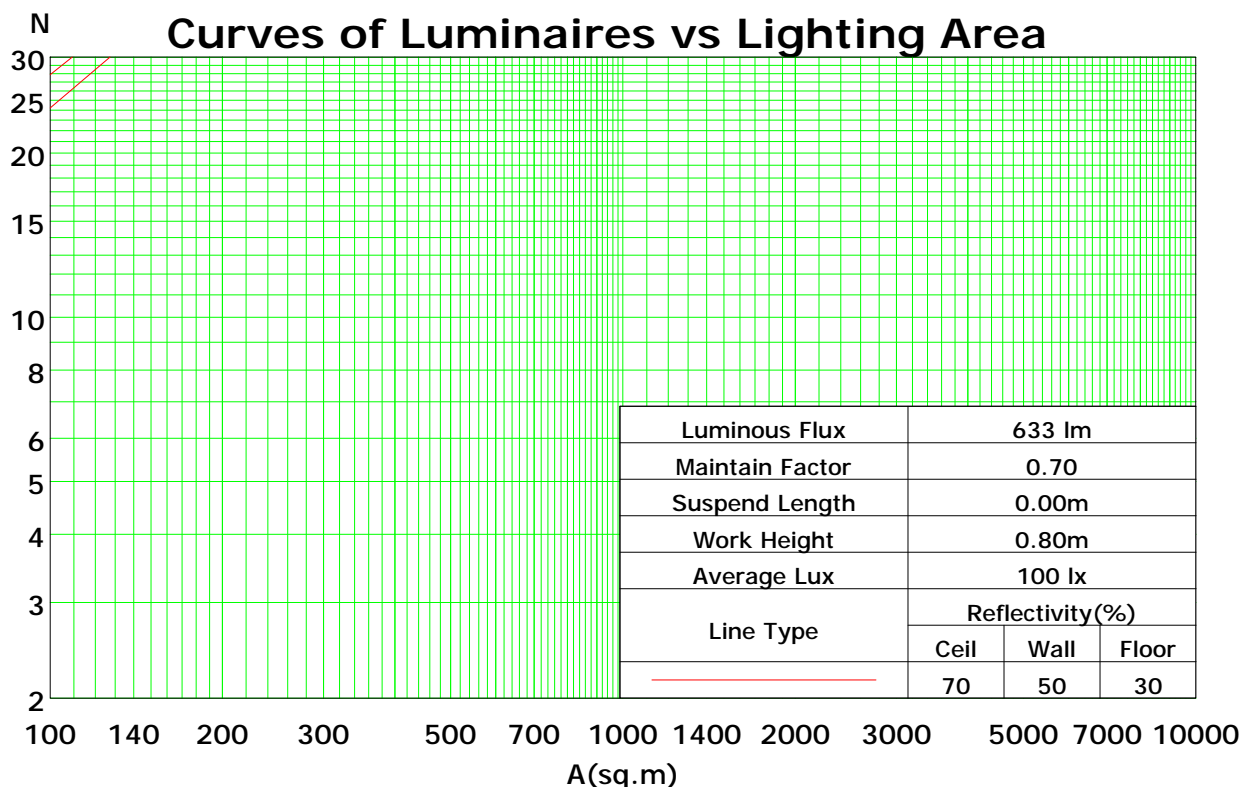

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

Isocandela (rectangle)



I_{max} (100%): 236 cd

(10%):	24 cd	(20%):	47 cd
(25%):	59 cd	(30%):	71 cd
(40%):	94 cd	(50%):	118 cd
(60%):	141 cd	(70%):	165 cd
(80%):	189 cd	(90%):	212 cd

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

IsoLux Plot



Mounting Height: 5.0m Max Lux(100%): 9.4 lx

(10%): 0.9 lx	(20%): 1.9 lx
(25%): 2.4 lx	(30%): 2.8 lx
(40%): 3.8 lx	(50%): 4.7 lx
(60%): 5.7 lx	(70%): 6.6 lx
(80%): 7.5 lx	(90%): 8.5 lx

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1800B

Distance: 9.028 m



Humidity: 60%

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h



L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	63889	61893	59454	56277	52070	46482	38573	28192	13987
C90	72116	71521	70426	68983	66775	63622	58111	42509	12394
C180	65367	63721	61781	59085	55596	50897	44174	34772	22403
C270	70354	69409	68099	66154	63638	59609	54029	45728	17448

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

Illuminance at a Distance



C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

Vertical IsoLux Plot



Lowest(m): 2.0m	Highest(m): 5.0m	Max Lux: 58.4 lx
(10%): 5.8 lx	(20%): 11.7 lx	
(25%): 14.6 lx	(30%): 17.5 lx	
(40%): 23.3 lx	(50%): 29.2 lx	
(60%): 35.0 lx	(70%): 40.9 lx	
(80%): 46.7 lx	(90%): 52.5 lx	

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%


Inspector:

Area Flux Table

Unit: lm

		Vertical plane																		Flux(T)		Flux(E)	
		-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90			
Horizontal plane	0.0	0.0	0.0	0.1	0.1	0.2	0.3	0.3	0.3	0.3	0.3	0.2	0.3	0.3	0.2	0.1	0.1	0.0	0.0	0.6	691		
	0.0	0.1	0.2	0.4	0.7	0.9	1.1	1.3	1.4	1.4	1.2	1.1	0.8	0.6	0.3	0.2	0.1	0.0	0.0	4.5		681	
	0.0	0.1	0.4	0.8	1.3	1.7	2.2	2.5	2.6	2.5	2.3	2.1	1.6	1.2	0.7	0.4	0.3	0.1	0.0	12.9			
	0.0	0.2	0.6	1.2	1.8	2.5	3.1	3.6	3.8	3.8	3.5	3.0	2.4	1.7	1.1	0.7	0.4	0.2	0.1	24.9			
	0.0	0.3	0.8	1.5	2.4	3.2	4.0	4.5	4.8	4.8	4.5	3.9	3.1	2.3	1.4	0.9	0.5	0.2	0.0	38.7			
	0.0	0.3	0.9	1.8	2.9	3.9	4.3	4.7	5.3	5.8	6.4	6.8	7.0	7.0	6.6	5.6	4.7	3.3	2.4	52.6			
	0.0	0.4	1.1	2.2	3.4	4.6	5.7	6.5	6.9	7.1	7.0	6.6	5.8	4.8	3.9	2.9	2.3	1.6	0.9	64.8			
	0.0	0.4	1.2	2.3	3.5	4.7	5.8	6.6	7.0	7.0	6.6	5.8	4.8	3.9	2.9	2.3	1.6	0.9	0.0	78.1			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	92.6			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	106.9			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	121.2			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	135.5			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	149.8			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	164.1			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	178.4			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	192.7			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	207.0			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	221.3			
	0.0	0.4	1.1	2.2	3.4	4.6	5.6	6.4	6.8	6.8	6.4	5.6	4.7	3.3	2.4	1.8	1.2	0.6	0.0	235.6			

The Average Illuminance Effective Figure



UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	27.8	29.5	28.2	29.8	30.1	27.8	29.5	28.2	29.8	30.1
3H	29.6	31.1	30.0	31.4	31.8	29.6	31.1	30.0	31.4	31.8
4H	30.2	31.6	30.7	32.0	32.4	30.2	31.6	30.6	31.9	32.3
6H	30.7	32.0	31.1	32.3	32.7	30.5	31.8	30.9	32.2	32.6
8H	30.8	32.0	31.2	32.4	32.8	30.6	31.8	31.0	32.2	32.6
12H	30.8	32.0	31.3	32.4	32.8	30.6	31.8	31.0	32.1	32.6
X=4H Y=2H	28.4	29.8	28.8	30.2	30.6	28.5	29.9	28.9	30.2	30.6
3H	30.4	31.6	30.8	32.0	32.4	30.4	31.6	30.9	32.0	32.4
4H	31.1	32.2	31.6	32.6	33.1	31.2	32.2	31.6	32.6	33.1
6H	31.6	32.6	32.1	33.0	33.5	31.6	32.5	32.1	33.0	33.5
8H	31.8	32.7	32.3	33.1	33.6	31.7	32.5	32.2	33.0	33.5
12H	31.9	32.7	32.4	33.1	33.6	31.7	32.5	32.2	33.0	33.4
X=8H Y=4H	31.4	32.2	31.8	32.7	33.2	31.5	32.3	31.9	32.8	33.3
6H	32.0	32.7	32.5	33.2	33.7	32.0	32.7	32.5	33.2	33.7
8H	32.2	32.8	32.7	33.3	33.8	32.1	32.8	32.7	33.3	33.8
12H	32.3	32.9	32.8	33.4	33.9	32.2	32.8	32.7	33.3	33.8
X=12H Y=4H	31.4	32.2	31.9	32.7	33.1	31.5	32.3	32.0	32.8	33.2
6H	32.0	32.7	32.5	33.1	33.7	32.1	32.7	32.6	33.2	33.7
8H	32.2	32.8	32.7	33.3	33.9	32.2	32.8	32.8	33.3	33.9

Calculate in accordance with CIE 190:2010

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25								
Room Reflectance			Room Index(RI)								
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	0.56	0.66	0.74	0.79	0.86	0.92	0.95	1.00	1.03
	0.30		0.48	0.58	0.66	0.72	0.80	0.86	0.90	0.96	0.99
	0.20		0.42	0.52	0.60	0.66	0.75	0.81	0.86	0.92	0.96
0.50	0.50	0.20	0.54	0.64	0.71	0.76	0.83	0.88	0.91	0.96	0.99
	0.30		0.47	0.57	0.64	0.70	0.78	0.83	0.87	0.92	0.96
	0.20		0.41	0.52	0.59	0.65	0.73	0.79	0.83	0.89	0.93
0.30	0.50	0.20	0.52	0.62	0.69	0.74	0.80	0.85	0.88	0.92	0.95
	0.30		0.46	0.56	0.63	0.68	0.76	0.81	0.84	0.89	0.92
	0.20		0.41	0.51	0.58	0.64	0.72	0.77	0.81	0.87	0.90
0.00	0.00	0.00	0.39	0.49	0.56	0.61	0.68	0.73	0.77	0.82	0.85
Rating: 6W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980											

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	1.01	0.84	0.71	0.62	0.49	0.41	0.35	0.27	0.22	
	0.30		0.84	0.71	0.62	0.55	0.45	0.38	0.32	0.26	0.21	
	0.20		0.72	0.62	0.55	0.49	0.41	0.35	0.30	0.24	0.20	
0.50	0.50	0.20	0.97	0.80	0.68	0.59	0.47	0.42	0.33	0.26	0.21	
	0.30		0.83	0.70	0.60	0.53	0.43	0.36	0.31	0.24	0.20	
	0.20		0.72	0.61	0.54	0.48	0.40	0.34	0.29	0.23	0.19	
0.30	0.50	0.20	0.95	0.77	0.66	0.57	0.45	0.37	0.32	0.25	0.20	
	0.30		0.81	0.68	0.59	0.52	0.42	0.35	0.30	0.23	0.19	
	0.20		0.71	0.61	0.53	0.47	0.39	0.33	0.28	0.22	0.19	
0.00	0.00	0.00	0.61	0.51	0.44	0.39	0.31	0.26	0.22	0.17	0.14	
Rating: 6W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25								
Room Reflectance			Room Index(RI)								
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	0.17	0.18	0.19	0.20	0.21	0.21	0.22	0.22	0.22
	0.30		0.10	0.12	0.13	0.14	0.16	0.17	0.18	0.19	0.20
	0.20		0.05	0.07	0.08	0.10	0.12	0.13	0.14	0.16	0.17
0.50	0.50	0.20	0.16	0.18	0.18	0.19	0.20	0.20	0.21	0.21	0.21
	0.30		0.10	0.11	0.13	0.14	0.15	0.16	0.17	0.18	0.19
	0.20		0.05	0.07	0.08	0.09	0.11	0.13	0.14	0.16	0.17
0.30	0.50	0.20	0.16	0.17	0.18	0.18	0.19	0.20	0.20	0.20	0.21
	0.30		0.10	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.18
	0.20		0.05	0.07	0.08	0.09	0.11	0.13	0.14	0.15	0.16
0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01
Rating: 6W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980											