

Report No.:

Test Time: 2018/8/30 09:37

Luminaire Property

Luminaire Manufacturer:

Luminaire Category: RIBBONLYTE

Luminaire Description: RBS2244.430PH 1FT(300mm)

Luminous Length (mm): 300

Luminous Width (mm): 8

Luminous Height (mm): 1

Voltage: 24.0 V

Current: 0.175 A

Power: 4.20 W

Power Factor: 1.000

Photometric Results

CIE Class: Direct

Measurement Flux: 549.3 lm

Downward Ratio: 99%

Horizontal Diffuse Angle(50%): H116.9

Vertical Diffuse Angle(50%): V116.6

Luminaire Efficacy Rating (LER): 131

Max. Intensity: 183.43 cd

Total Rated Lamp Lumens: 549.3 lm


Efficiency: 100%

Upward Ratio: 1%


Central Intensity: 182.61 cd

Pos of Max. Intensity: H150 V0

Picture Of Luminaire



Luminous Intensity Distribution Curve



Average Diffuse Angle(50%): 116.8° Unit: cd

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:


Luminous Intensity Distribution Curve



C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1800B
Distance: 9.028 m
Humidity: 60%
Inspector:

Luminous Intensity Distribution Curve(cd/klm)



C Plane (°):0.0-360.0: 30.0
Test Lab:
Test Type: TYPE C
Temperature: 25
Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1800B
Distance: 9.028 m
Humidity: 60%
Inspector:


Coefficients Of Utilization - Zonal Cavity Method

| | | | | | | | | | | | | | | | | | | |
|-----|----------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|
| RC | 0.8 | 0.8 | 0.8 | 0.8 | 0.7 | 0.7 | 0.7 | 0.7 | 0.5 | 0.5 | 0.5 | 0.3 | 0.3 | 0.3 | 0.1 | 0.1 | 0.1 | 0 |
| RW | 0.7 | 0.5 | 0.3 | 0.1 | 0.7 | 0.5 | 0.3 | 0.1 | 0.5 | 0.3 | 0.1 | 0.5 | 0.3 | 0.1 | 0.5 | 0.3 | 0.1 | 0 |
| RCR | RF = 0.2 | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 101 | 101 | 101 | 99 |
| 1 | 108 | 104 | 99 | 95 | 106 | 101 | 97 | 94 | 97 | 94 | 91 | 93 | 90 | 88 | 89 | 87 | 85 | 83 |
| 2 | 98 | 90 | 83 | 77 | 96 | 88 | 82 | 76 | 84 | 79 | 74 | 81 | 77 | 73 | 78 | 74 | 71 | 69 |
| 3 | 90 | 79 | 71 | 64 | 87 | 77 | 69 | 63 | 74 | 67 | 62 | 71 | 66 | 61 | 69 | 64 | 60 | 58 |
| 4 | 82 | 70 | 61 | 54 | 79 | 68 | 60 | 53 | 66 | 58 | 53 | 63 | 57 | 52 | 61 | 56 | 51 | 49 |
| 5 | 75 | 62 | 53 | 46 | 73 | 61 | 52 | 46 | 59 | 51 | 45 | 57 | 50 | 45 | 55 | 49 | 44 | 42 |
| 6 | 69 | 56 | 47 | 40 | 67 | 55 | 46 | 40 | 53 | 45 | 40 | 51 | 44 | 39 | 50 | 44 | 39 | 37 |
| 7 | 64 | 51 | 42 | 35 | 62 | 50 | 41 | 35 | 48 | 40 | 35 | 47 | 40 | 35 | 45 | 39 | 34 | 32 |
| 8 | 60 | 46 | 37 | 32 | 58 | 45 | 37 | 31 | 44 | 36 | 31 | 43 | 36 | 31 | 41 | 35 | 31 | 29 |
| 9 | 56 | 42 | 34 | 28 | 54 | 42 | 34 | 28 | 40 | 33 | 28 | 39 | 33 | 28 | 38 | 32 | 28 | 26 |
| 10 | 52 | 39 | 31 | 26 | 51 | 38 | 31 | 26 | 37 | 30 | 25 | 36 | 30 | 25 | 35 | 29 | 25 | 23 |

Spacing Criteria (0-180): 1.28

Spacing Criteria (90-270): 1.28

Spacing Criteria (Diagonal): 1.41

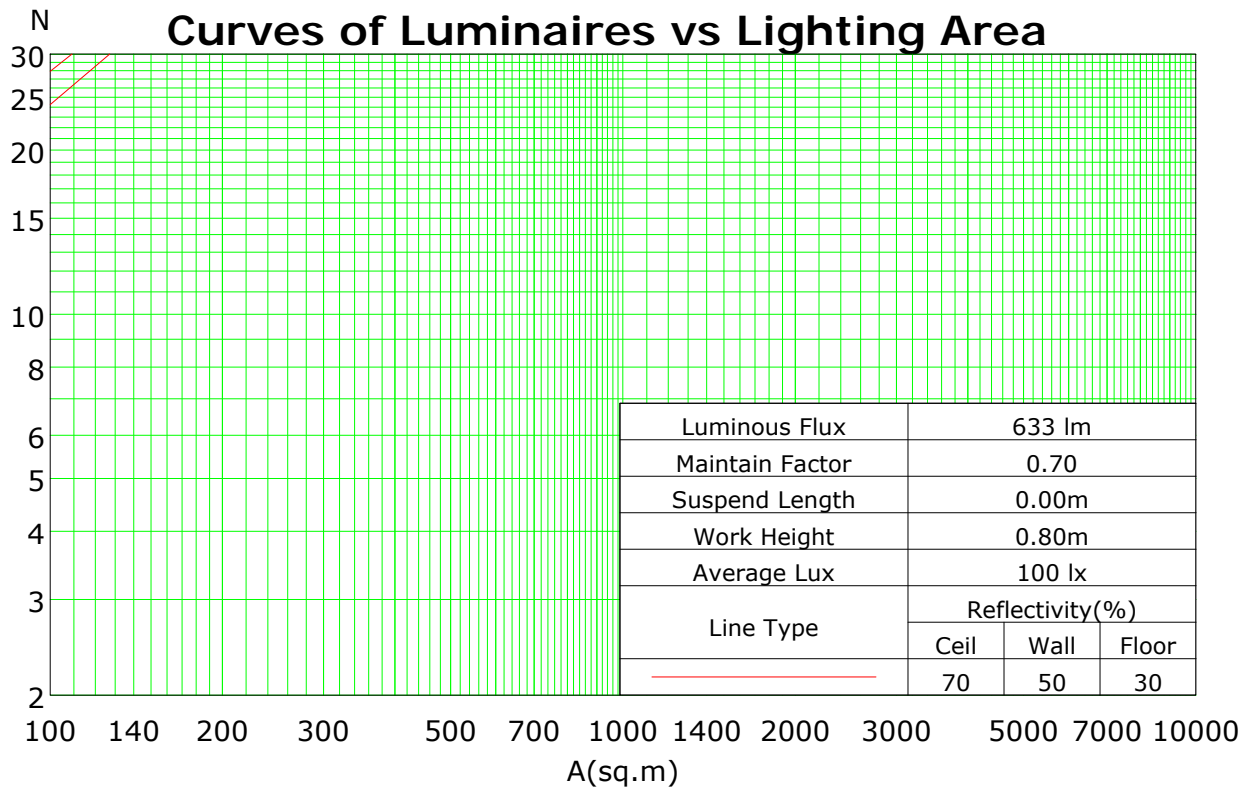

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

Isocandela (rectangle)



Imax (100%): 183 cd

| | |
|----------------|----------------|
| (10%): 18 cd | (20%): 37 cd |
| (25%): 46 cd | (30%): 55 cd |
| (40%): 73 cd | (50%): 92 cd |
| (60%): 110 cd | (70%): 128 cd |
| (80%): 147 cd | (90%): 165 cd |

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

IsoLux Plot



C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1800B

Distance: 9.028 m



Humidity: 60%

Inspector:

Lum Limit Curve

| Dazzle | Quality | Illuminance (lx) | | | | | | | |
|--------|---------|------------------|------|------|-------|-------|-------|-------|-------|
| 1.15 | A | 2000 | 1000 | 500 | <=300 | | | | |
| 1.50 | B | | 2000 | 1000 | 500 | <=300 | | | |
| 1.85 | C | | | 2000 | 1000 | 500 | <=300 | | |
| 2.20 | D | | | | 2000 | 1000 | 500 | <=300 | |
| 2.55 | E | | | | | 2000 | 1000 | 500 | <=300 |

a b c d e f g h



| L(cd/sq.m) | G45 | G50 | G55 | G60 | G65 | G70 | G75 | G80 | G85 |
|------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| C0 | 67788 | 65963 | 63705 | 60857 | 56734 | 51172 | 43790 | 33263 | 19841 |
| C90 | 75521 | 74902 | 74035 | 72548 | 70237 | 66794 | 61425 | 45781 | 11835 |
| C180 | 65819 | 63735 | 61214 | 57843 | 53523 | 47381 | 39234 | 28026 | 14448 |
| C270 | 74358 | 73598 | 72336 | 70617 | 68006 | 63981 | 58197 | 49454 | 19664 |

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

Illuminance at a Distance



C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

Vertical IsoLux Plot



| | | |
|-----------------|------------------|------------------|
| Lowest(m): 2.0m | Highest(m): 5.0m | Max Lux: 45.7 lx |
| (10%): 4.6 lx | (20%): 9.1 lx | |
| (25%): 11.4 lx | (30%): 13.7 lx | |
| (40%): 18.3 lx | (50%): 22.8 lx | |
| (60%): 27.4 lx | (70%): 32.0 lx | |
| (80%): 36.5 lx | (90%): 41.1 lx | |

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

Area Flux Table

Unit: lm

| | | Vertical plane | | | | | | | | | | | | | | | | | | | | |
|------------------|-----|----------------|-----|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|-----|-----|-----|---------|---------|
| | | -90 | -80 | -70 | -60 | -50 | -40 | -30 | -20 | -10 | 0 | 10 | 20 | 30 | 40 | 50 | 60 | 70 | 80 | 90 | Flux(T) | Flux(E) |
| Horizontal plane | -90 | 0.0 | 0.0 | 0.0 | 0.1 | 0.1 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.0 | 546 | 538 |
| | -80 | 0.0 | 0.0 | 0.1 | 0.3 | 0.5 | 0.7 | 0.9 | 1.0 | 1.1 | 1.1 | 1.1 | 0.9 | 0.7 | 0.5 | 0.3 | 0.2 | 0.1 | 0.0 | 0.0 | 2.3 | 0.2 |
| | -70 | 0.0 | 0.1 | 0.3 | 0.6 | 0.9 | 1.3 | 1.7 | 1.9 | 2.1 | 2.1 | 2.0 | 1.7 | 1.4 | 1.0 | 0.6 | 0.3 | 0.1 | 0.0 | 0.0 | 9.5 | 8.6 |
| | -60 | 0.0 | 0.1 | 0.4 | 0.9 | 1.4 | 1.9 | 2.4 | 2.8 | 3.0 | 3.0 | 2.9 | 2.5 | 2.0 | 1.4 | 0.9 | 0.5 | 0.2 | 0.1 | 0.0 | 18.2 | 17.9 |
| | -50 | 0.0 | 0.2 | 0.6 | 1.1 | 1.8 | 2.5 | 3.1 | 3.6 | 3.8 | 3.8 | 3.6 | 3.2 | 2.6 | 1.9 | 1.2 | 0.6 | 0.3 | 0.1 | 0.0 | 26.5 | 26.3 |
| | -40 | 0.0 | 0.2 | 0.7 | 1.4 | 2.1 | 2.9 | 3.6 | 4.2 | 4.5 | 4.5 | 4.2 | 3.7 | 3.0 | 2.2 | 1.4 | 0.7 | 0.3 | 0.2 | 0.0 | 33.8 | 33.7 |
| | -30 | 0.0 | 0.3 | 0.8 | 1.5 | 2.4 | 3.3 | 4.1 | 4.6 | 5.0 | 5.0 | 4.7 | 4.1 | 3.4 | 2.5 | 1.6 | 0.8 | 0.3 | 0.3 | 0.0 | 44.5 | 44.5 |
| | -20 | 0.0 | 0.3 | 0.9 | 1.7 | 2.6 | 3.5 | 4.4 | 5.0 | 5.3 | 5.3 | 5.0 | 4.4 | 3.6 | 2.7 | 1.7 | 0.9 | 0.3 | 0.3 | 0.0 | 47.7 | 47.6 |
| | -10 | 0.0 | 0.3 | 0.9 | 1.7 | 2.7 | 3.7 | 4.5 | 5.1 | 5.5 | 5.5 | 5.2 | 4.6 | 3.7 | 2.8 | 1.8 | 0.9 | 0.3 | 0.3 | 0.0 | 49.3 | 49.2 |
| | 0 | 0.0 | 0.3 | 0.9 | 1.7 | 2.7 | 3.7 | 4.5 | 5.1 | 5.5 | 5.5 | 5.2 | 4.6 | 3.7 | 2.8 | 1.8 | 0.9 | 0.3 | 0.3 | 0.0 | 49.3 | 49.3 |
| | 10 | 0.0 | 0.3 | 0.9 | 1.7 | 2.6 | 3.6 | 4.4 | 5.0 | 5.3 | 5.3 | 5.0 | 4.4 | 3.6 | 2.7 | 1.7 | 0.9 | 0.3 | 0.3 | 0.0 | 47.8 | 47.8 |
| | 20 | 0.0 | 0.3 | 0.8 | 1.6 | 2.4 | 3.3 | 4.1 | 4.7 | 5.0 | 5.0 | 4.7 | 4.2 | 3.4 | 2.5 | 1.6 | 0.8 | 0.3 | 0.3 | 0.0 | 44.8 | 44.7 |
| | 30 | 0.0 | 0.2 | 0.7 | 1.4 | 2.2 | 3.0 | 3.7 | 4.2 | 4.5 | 4.5 | 4.3 | 3.8 | 3.1 | 2.3 | 1.5 | 0.8 | 0.3 | 0.3 | 0.0 | 40.2 | 40.2 |
| | 40 | 0.0 | 0.2 | 0.6 | 1.1 | 1.8 | 2.5 | 3.1 | 3.6 | 3.9 | 3.9 | 3.7 | 3.2 | 2.6 | 1.9 | 1.2 | 0.6 | 0.2 | 0.2 | 0.0 | 34.3 | 34.2 |
| | 50 | 0.0 | 0.1 | 0.4 | 0.9 | 1.4 | 2.0 | 2.5 | 2.9 | 3.1 | 3.1 | 2.9 | 2.5 | 2.1 | 1.5 | 1.0 | 0.5 | 0.2 | 0.2 | 0.0 | 27.0 | 26.8 |
| | 60 | 0.0 | 0.1 | 0.3 | 0.6 | 1.0 | 1.4 | 1.7 | 2.0 | 2.1 | 2.2 | 2.0 | 1.8 | 1.4 | 1.0 | 0.7 | 0.3 | 0.1 | 0.0 | 0.0 | 18.7 | 18.4 |
| | 70 | 0.0 | 0.0 | 0.1 | 0.3 | 0.5 | 0.7 | 0.9 | 1.1 | 1.1 | 1.2 | 1.1 | 1.0 | 0.8 | 0.6 | 0.4 | 0.2 | 0.1 | 0.0 | 0.0 | 10.0 | 9.1 |
| | 80 | 0.0 | 0.0 | 0.0 | 0.1 | 0.1 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.1 | 0.1 | 0.0 | 0.0 | 0.0 | 2.3 | 0.1 |
| | 90 | 0.3 | 3.0 | 9.3 | 18.5 | 29.3 | 40.3 | 50.0 | 57.2 | 61.1 | 61.4 | 58.0 | 51.2 | 41.7 | 30.8 | 19.8 | 10.2 | 3.5 | 0.4 | 0.4 | 546 | |

C Plane (°):0.0-360.0: 30.0

Test Lab:

Test Type: TYPE C

Temperature: 25

Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0


Test Device: GPM-1800B

Distance: 9.028 m

Humidity: 60%

Inspector:

The Average Illuminance Effective Figure



C Plane (°):0.0-360.0: 30.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 25
 Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 9.028 m
 Humidity: 60%
 Inspector:

UGR Table

| | | | | | | | | | | |
|------------------|------------------|------|------|------|------|----------------|------|------|------|------|
| Reflectance: | | | | | | | | | | |
| Ceiling (cavity) | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 |
| Wall | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 |
| Reference plane | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Room dimensions | Viewed crosswise | | | | | Viewed endwise | | | | |
| X=2H Y=2H | 29.2 | 30.8 | 29.6 | 31.1 | 31.5 | 28.7 | 30.3 | 29.1 | 30.7 | 31.0 |
| 3H | 31.1 | 32.6 | 31.5 | 32.9 | 33.3 | 30.4 | 31.9 | 30.8 | 32.2 | 32.6 |
| 4H | 31.8 | 33.2 | 32.2 | 33.5 | 33.9 | 31.0 | 32.4 | 31.4 | 32.8 | 33.2 |
| 6H | 32.3 | 33.6 | 32.7 | 34.0 | 34.4 | 31.4 | 32.7 | 31.8 | 33.0 | 33.4 |
| 8H | 32.4 | 33.7 | 32.9 | 34.1 | 34.5 | 31.4 | 32.6 | 31.8 | 33.0 | 33.5 |
| 12H | 32.5 | 33.7 | 33.0 | 34.1 | 34.6 | 31.4 | 32.6 | 31.8 | 33.0 | 33.4 |
| X=4H Y=2H | 29.8 | 31.2 | 30.2 | 31.5 | 31.9 | 29.4 | 30.8 | 29.8 | 31.1 | 31.5 |
| 3H | 31.9 | 33.0 | 32.3 | 33.4 | 33.9 | 31.3 | 32.5 | 31.7 | 32.9 | 33.3 |
| 4H | 32.7 | 33.7 | 33.1 | 34.2 | 34.6 | 32.0 | 33.1 | 32.4 | 33.5 | 33.9 |
| 6H | 33.3 | 34.2 | 33.8 | 34.7 | 35.2 | 32.4 | 33.4 | 32.9 | 33.8 | 34.3 |
| 8H | 33.5 | 34.4 | 34.0 | 34.8 | 35.3 | 32.5 | 33.4 | 33.0 | 33.8 | 34.3 |
| 12H | 33.6 | 34.4 | 34.1 | 34.9 | 35.4 | 32.5 | 33.3 | 33.0 | 33.8 | 34.3 |
| X=8H Y=4H | 32.9 | 33.8 | 33.4 | 34.3 | 34.7 | 32.3 | 33.2 | 32.8 | 33.6 | 34.1 |
| 6H | 33.6 | 34.4 | 34.2 | 34.9 | 35.4 | 32.8 | 33.6 | 33.3 | 34.1 | 34.5 |
| 8H | 33.9 | 34.6 | 34.4 | 35.1 | 35.6 | 33.0 | 33.6 | 33.5 | 34.1 | 34.6 |
| 12H | 34.1 | 34.7 | 34.6 | 35.2 | 35.8 | 33.0 | 33.6 | 33.5 | 34.1 | 34.6 |
| X=12H Y=4H | 33.0 | 33.7 | 33.4 | 34.2 | 34.7 | 32.3 | 33.1 | 32.8 | 33.6 | 34.1 |
| 6H | 33.7 | 34.4 | 34.2 | 34.8 | 35.4 | 32.9 | 33.5 | 33.4 | 34.0 | 34.6 |
| 8H | 34.0 | 34.6 | 34.5 | 35.1 | 35.6 | 33.0 | 33.6 | 33.6 | 34.1 | 34.7 |

Calculate in accordance with CIE 190:2010

C Plane (°):0.0-360.0: 30.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 25
 Operator: Aaron

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 9.028 m
 Humidity: 60%
 Inspector:

Utilisation Factor Table(Floor cavity)

| Utilisation Factors UF(F) | | | SHR NOM = 1.25 | | | | | | | | |
|--|------|-------|----------------|------|------|------|------|------|------|------|------|
| Room Reflectance | | | Room Index(RI) | | | | | | | | |
| Ceiling | Wall | Floor | 0.75 | 1.00 | 1.25 | 1.50 | 2.00 | 2.50 | 3.00 | 4.00 | 5.00 |
| 0.70 | 0.50 | 0.20 | 0.55 | 0.66 | 0.73 | 0.79 | 0.86 | 0.92 | 0.95 | 1.00 | 1.03 |
| | 0.30 | | 0.47 | 0.58 | 0.66 | 0.72 | 0.80 | 0.86 | 0.90 | 0.96 | 0.99 |
| | 0.20 | | 0.42 | 0.52 | 0.60 | 0.66 | 0.75 | 0.81 | 0.86 | 0.92 | 0.96 |
| 0.50 | 0.50 | 0.20 | 0.54 | 0.64 | 0.71 | 0.76 | 0.83 | 0.88 | 0.91 | 0.96 | 0.99 |
| | 0.30 | | 0.46 | 0.57 | 0.64 | 0.70 | 0.78 | 0.83 | 0.87 | 0.92 | 0.96 |
| | 0.20 | | 0.41 | 0.52 | 0.59 | 0.65 | 0.73 | 0.79 | 0.83 | 0.89 | 0.93 |
| 0.30 | 0.50 | 0.20 | 0.52 | 0.62 | 0.68 | 0.73 | 0.80 | 0.85 | 0.88 | 0.92 | 0.95 |
| | 0.30 | | 0.46 | 0.56 | 0.63 | 0.68 | 0.76 | 0.81 | 0.84 | 0.89 | 0.92 |
| | 0.20 | | 0.41 | 0.51 | 0.58 | 0.64 | 0.72 | 0.77 | 0.81 | 0.87 | 0.90 |
| 0.00 | 0.00 | 0.00 | 0.39 | 0.48 | 0.55 | 0.61 | 0.68 | 0.73 | 0.77 | 0.82 | 0.85 |
| Rating:4W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980 | | | | | | | | | | | |

Utilisation Factor Table(Wall)

| Utilisation Factors UF(W) | | | SHR NOM = 1.25 | | | | | | | | | |
|--|------|-------|----------------|------|------|------|------|------|------|------|------|--|
| Room Reflectance | | | Room Index(RI) | | | | | | | | | |
| Ceiling | Wall | Floor | 0.75 | 1.00 | 1.25 | 1.50 | 2.00 | 2.50 | 3.00 | 4.00 | 5.00 | |
| 0.70 | 0.50 | 0.20 | 1.01 | 0.84 | 0.71 | 0.62 | 0.50 | 0.41 | 0.35 | 0.27 | 0.22 | |
| | 0.30 | | 0.85 | 0.72 | 0.62 | 0.55 | 0.45 | 0.38 | 0.33 | 0.26 | 0.21 | |
| | 0.20 | | 0.73 | 0.63 | 0.55 | 0.49 | 0.41 | 0.35 | 0.30 | 0.24 | 0.20 | |
| 0.50 | 0.50 | 0.20 | 0.98 | 0.81 | 0.68 | 0.60 | 0.47 | 0.43 | 0.34 | 0.26 | 0.21 | |
| | 0.30 | | 0.83 | 0.70 | 0.61 | 0.53 | 0.43 | 0.36 | 0.31 | 0.25 | 0.20 | |
| | 0.20 | | 0.72 | 0.62 | 0.54 | 0.48 | 0.40 | 0.34 | 0.29 | 0.23 | 0.19 | |
| 0.30 | 0.50 | 0.20 | 0.95 | 0.77 | 0.66 | 0.57 | 0.45 | 0.38 | 0.32 | 0.25 | 0.20 | |
| | 0.30 | | 0.81 | 0.68 | 0.59 | 0.52 | 0.42 | 0.35 | 0.30 | 0.24 | 0.19 | |
| | 0.20 | | 0.71 | 0.61 | 0.53 | 0.47 | 0.39 | 0.33 | 0.29 | 0.23 | 0.19 | |
| 0.00 | 0.00 | 0.00 | 0.61 | 0.51 | 0.44 | 0.39 | 0.31 | 0.26 | 0.23 | 0.18 | 0.14 | |
| Rating:4W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980 | | | | | | | | | | | | |

Utilisation Factor Table(Ceiling cavity)

| Utilisation Factors UF(C) | | | SHR NOM = 1.25 | | | | | | | | | |
|--|------|-------|----------------|------|------|------|------|------|------|------|------|--|
| Room Reflectance | | | Room Index(RI) | | | | | | | | | |
| Ceiling | Wall | Floor | 0.75 | 1.00 | 1.25 | 1.50 | 2.00 | 2.50 | 3.00 | 4.00 | 5.00 | |
| 0.70 | 0.50 | 0.20 | 0.17 | 0.18 | 0.19 | 0.20 | 0.21 | 0.21 | 0.22 | 0.22 | 0.22 | |
| | 0.30 | | 0.10 | 0.12 | 0.13 | 0.14 | 0.16 | 0.17 | 0.18 | 0.19 | 0.20 | |
| | 0.20 | | 0.05 | 0.07 | 0.08 | 0.09 | 0.12 | 0.13 | 0.14 | 0.16 | 0.17 | |
| 0.50 | 0.50 | 0.20 | 0.16 | 0.18 | 0.18 | 0.19 | 0.20 | 0.20 | 0.21 | 0.21 | 0.21 | |
| | 0.30 | | 0.10 | 0.11 | 0.13 | 0.14 | 0.15 | 0.16 | 0.17 | 0.18 | 0.19 | |
| | 0.20 | | 0.05 | 0.07 | 0.08 | 0.09 | 0.11 | 0.13 | 0.14 | 0.16 | 0.17 | |
| 0.30 | 0.50 | 0.20 | 0.16 | 0.17 | 0.18 | 0.18 | 0.19 | 0.20 | 0.20 | 0.20 | 0.21 | |
| | 0.30 | | 0.10 | 0.11 | 0.12 | 0.13 | 0.15 | 0.16 | 0.17 | 0.18 | 0.18 | |
| | 0.20 | | 0.05 | 0.07 | 0.08 | 0.09 | 0.11 | 0.13 | 0.14 | 0.15 | 0.16 | |
| 0.00 | 0.00 | 0.00 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | |
| Rating:4W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980 | | | | | | | | | | | | |