

Test report

Print date 6/18/2026
Light measurement results



Laboratory and Equipment

Test lab
Spectrometer Manufacturer and Model
Measurement date
Operator

Viso LabSpion - serial: 1996407700 sensor serial: 1118720440 - Test lab
LabSpion – Type C, horizontal
6/4/2026
MW

Measurement Conditions

Tested c-planes
Tested gamma resolution
Input Power

12 planes – 30°
1°
4.8 W

Tested Light Source

Luminaire
Basic Luminous Shape
Item No.
Manufacturer
Description

Acolyte channel AR29L
PANEL
CHAR29L20GSWS2203.030
GenLEDBrands
0.5m RB90SWS2203.030\line Grazor lens 20° + grille louver

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)
Efficiency
Peak Intensity
Correlated Color Temperature, CCT
Color Rendering Index
Dominant Wavelength
Peak Wavelength


302 lm – 0.22% / 99.78%
63 lm/W
648 cd
3035 K
CRI 96.0
584 nm
619 nm

Lumen per length
Watt per length

603.11 lm/m 183.83 lm/ft
9.65 W/m 2.94 W/ft

Polar light distribution diagram

Unit: 0-100% of peak intensity

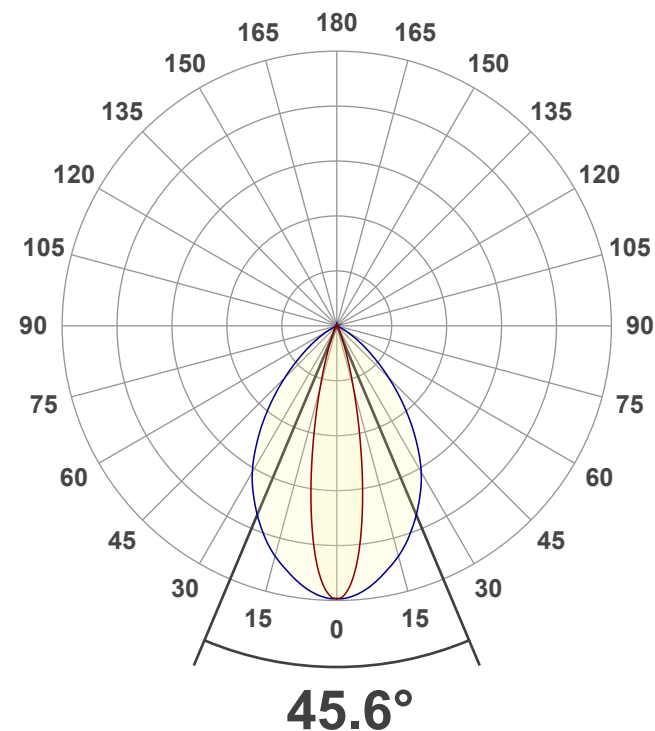


— C0 - C180
— C90 - C270

$\eta = 100.0\%$

63 lm/W

3035 K

Product photo

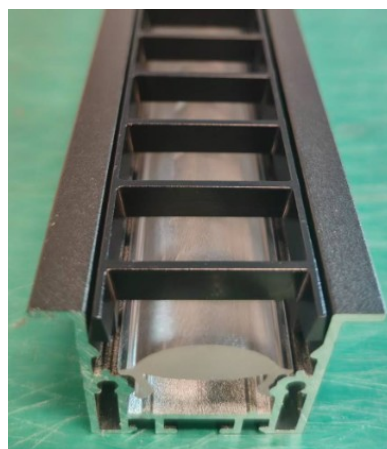

Test report

Print date 6/18/2026
Light measurement results



Color Parameters


Correlated Color Temperature, Target
Correlated Color Temperature, Measured
Color Rendering Index
Color Rendering Index, R9 (red)
Color Rendering TM30-18

CCT = 3035 K
CCT = 3035 K
CRI 96.0
R9 = 71.2
Rf 91.6
Rg 100.7


MacAdam Steps
Color deviation from BBL
Color coordinates CIE 1931
Color coordinate CIEs 1960
Color coordinate CIEs 1976
Color Quality Scale

SDCM = n/a
Duv = -0.0018
(x;y) = (0.432;0.398)
(u;v) = (0.250;0.346)
(u';v') = (0.250;0.518)
CQS = 92.4


CIE 1931 Chromaticity diagram

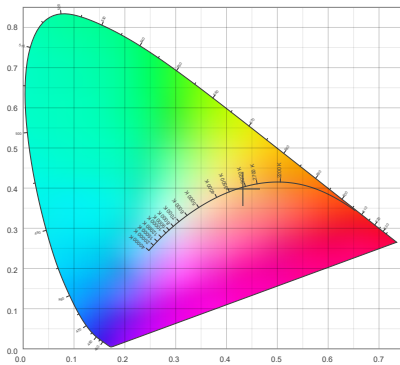


CIE 1931 Chromaticity - zoomed

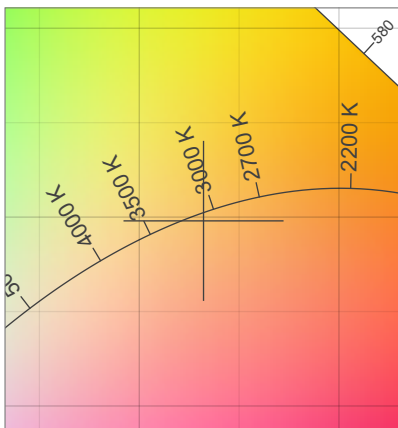


CIE 1931 Chromaticity - SDCM

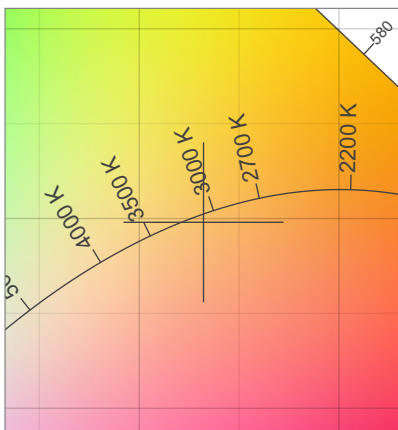

Spectral power distribution

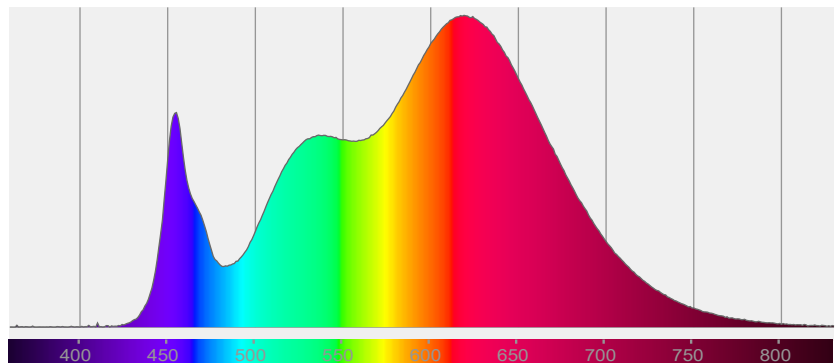


Color Rendering Index per reference color (CIE 1995)

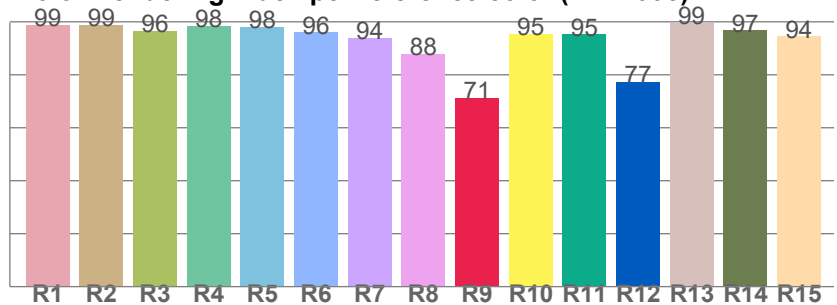

CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
98.8	98.9	96.5	98.4	97.9	95.9	93.9	87.7	71.2	95.3	95.2	77.3	99.5	96.7	94.5

TM30-18 Rf-values per hue bin

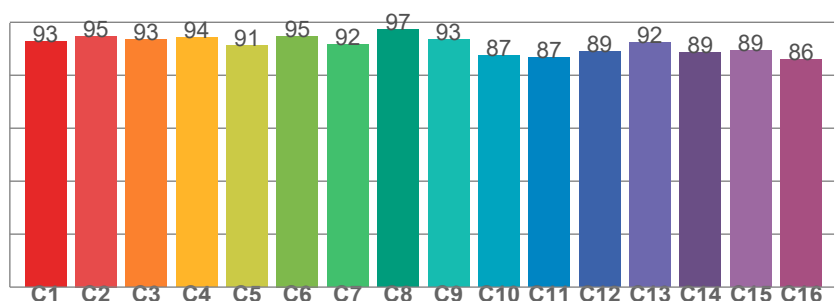

TM30-18 Rf-values per hue bin

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
92.8	94.8	93.5	94.3	91.3	94.8	91.6	97.4	93.4	87.5	86.7	89.1	92.3	88.6	89.4	85.9


Test report

Print date 6/18/2026
Light measurement results



Color details - ANSI/IES TM-30-18 Color Rendition Report

Color Vector Graphic

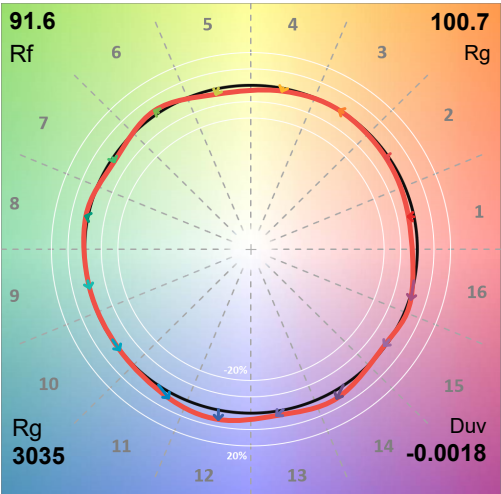

Color Distortion Graphic




CIE x 0.432
CIE y 0.432
CIE u' 0.250
CIE v' 0.518

CIE 13.3-1995

Ra 96.0


R9 71.2

Color Rendition by Color Evaluation Sample (CES)

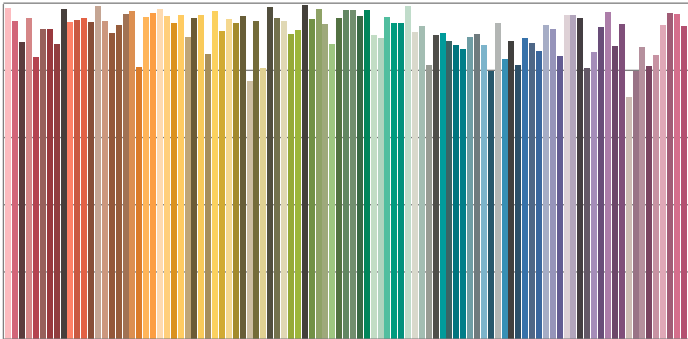


Color evaluation sample CES01 through CES99

Local Color Fidelity (per hue bin)

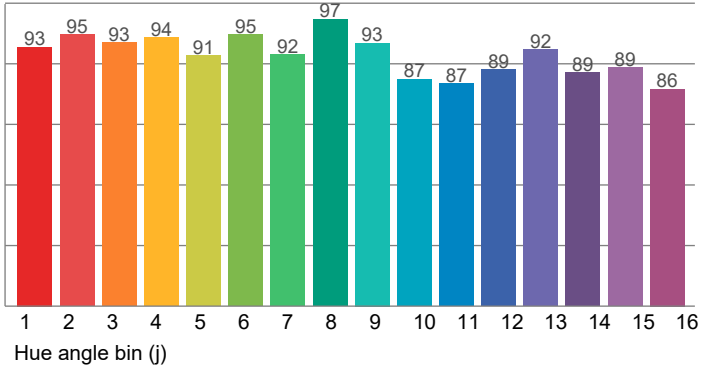

Local Chroma Shift (per hue bin)

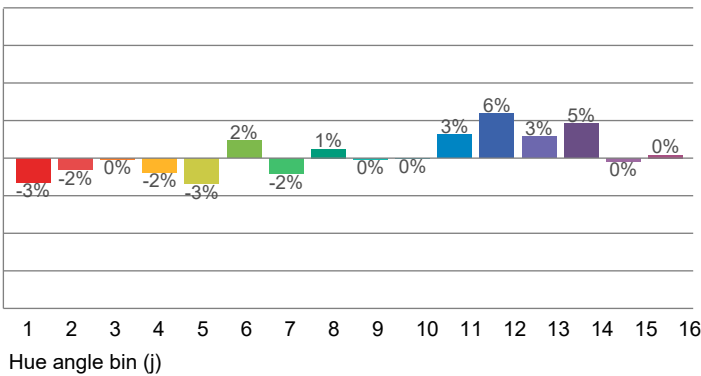


Test report

Print date 6/18/2026
Light measurement results



Color Rendering Index (CQS)

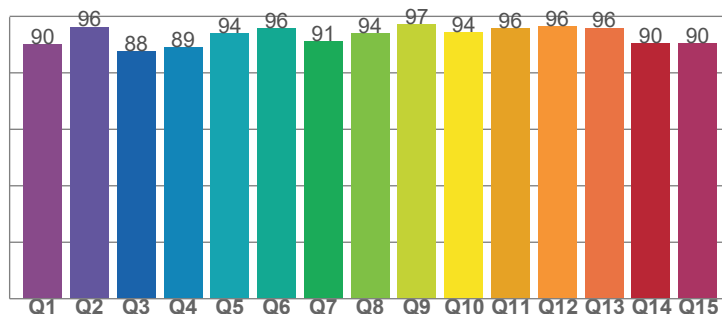

Q1	90.03	Q9	97.05
Q2	96.28	Q10	94.44
Q3	87.73	Q11	95.89
Q4	88.97	Q12	96.42
Q5	93.87	Q13	95.93
Q6	95.78	Q14	90.38
Q7	91.06	Q15	90.32
Q8	93.90	CQS	92.39

Hue Bin	Rf	Shifts (%)	
		Chroma	Hue
1	93	-3%	1%
2	95	-2%	1%
3	93	0%	3%
4	94	-2%	0%
5	91	-3%	2%
6	95	2%	1%
7	92	-2%	1%
8	97	1%	0%
9	93	0%	5%
10	87	0%	7%
11	87	3%	9%
12	89	6%	1%
13	92	3%	-5%
14	89	5%	-8%
15	89	0%	-4%
16	86	0%	-11%

Rg 100.7


Gamut Index Rf

Gamut index

Rf 91.6

Fidelity Index Rf

Gamut Index vs. Fidelity

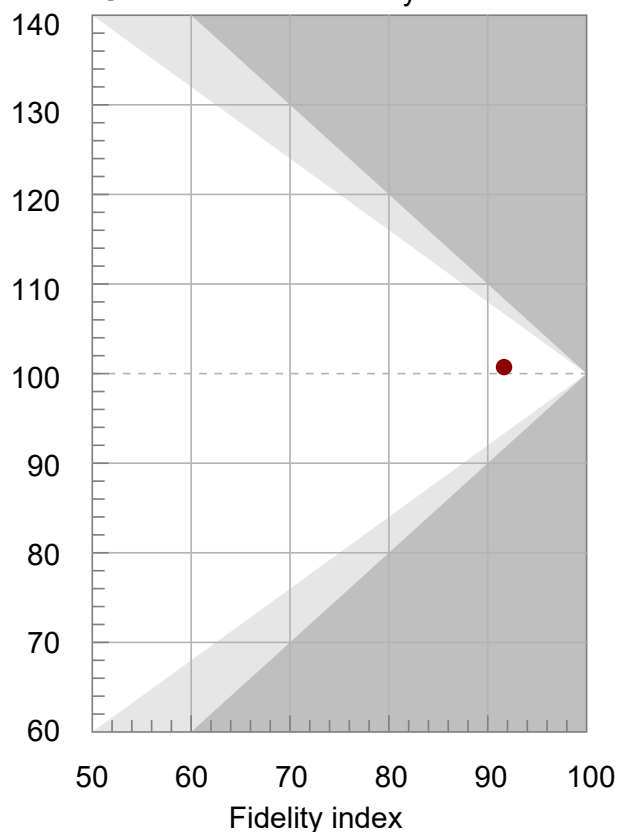


Test report

Print date 6/18/2026
Light measurement results



Luminous Intensity diagram

Unit: 0-100% of peak intensity

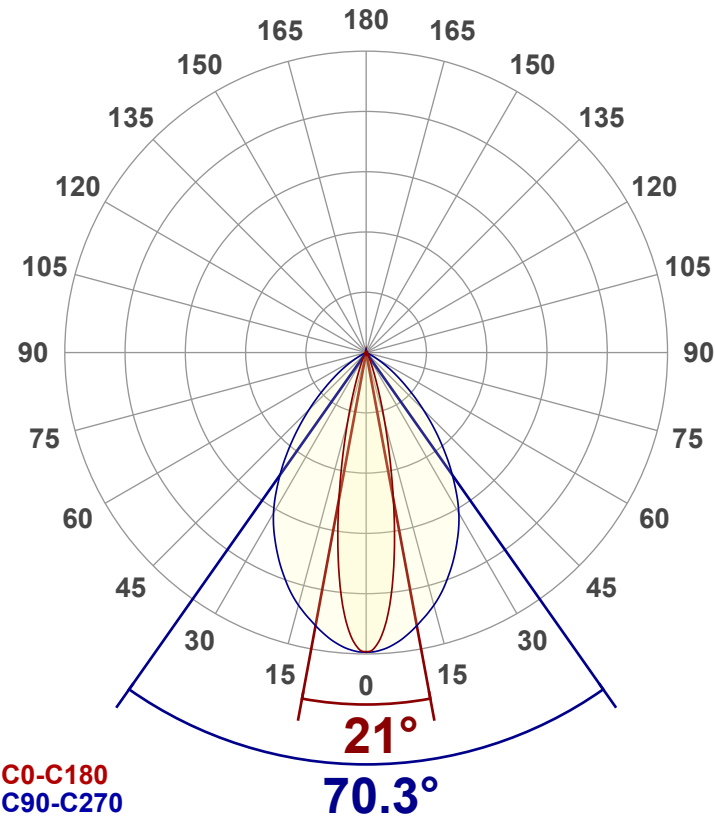

Main Values


Output (total Lumen)	302 lm
Lumen Up% / Down%	0.22% / 99.78%
Peak Intensity	648 cd
Beam Angle (50%-FWHM)	45.64°
Field Angle (10%-FWHM)	74.15°
Cutoff Angle (2.5%-FWHM)	{c_ANG/0.00}°

Intensity Ratios

In 120° cone	603.1
In 90° cone	183.8

Linear distribution diagram

Intensity [cd]

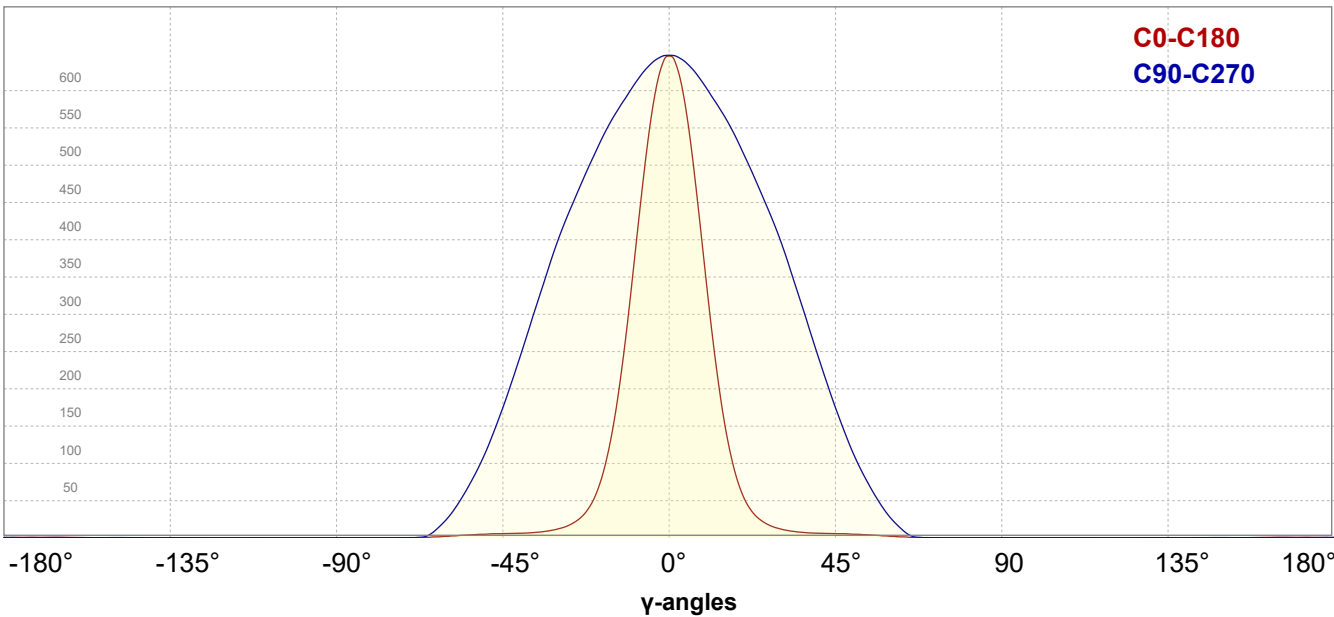


Test report


Print date 6/18/2026
Light measurement results



Iso-intensity Diagram (Iso-candela)

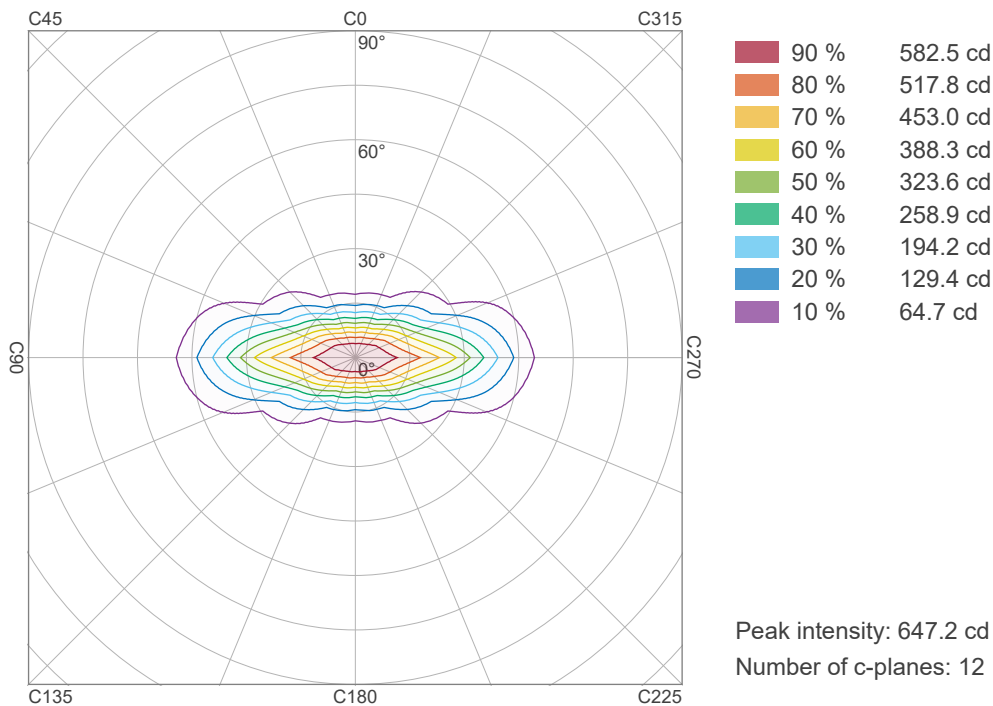

Iso-illuminance Diagram (Iso-lux)

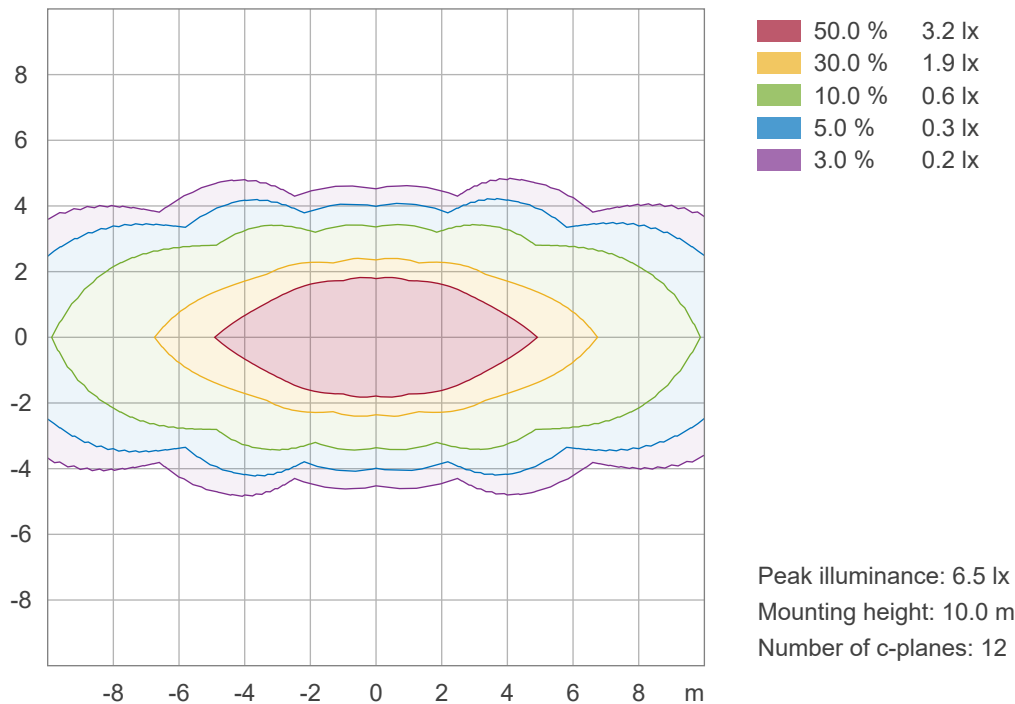


Test report

Print date 6/18/2026
Light measurement results




Beam details

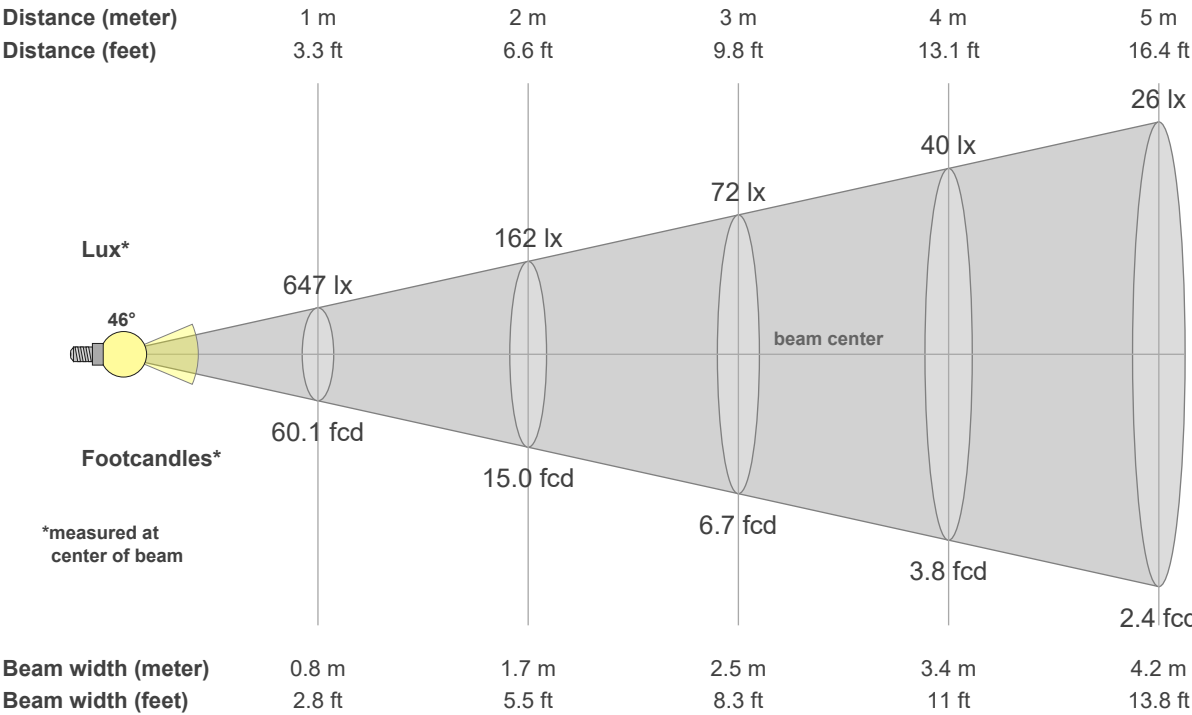

Luminaire budgetary diagram

LAMPS (number of lamps)

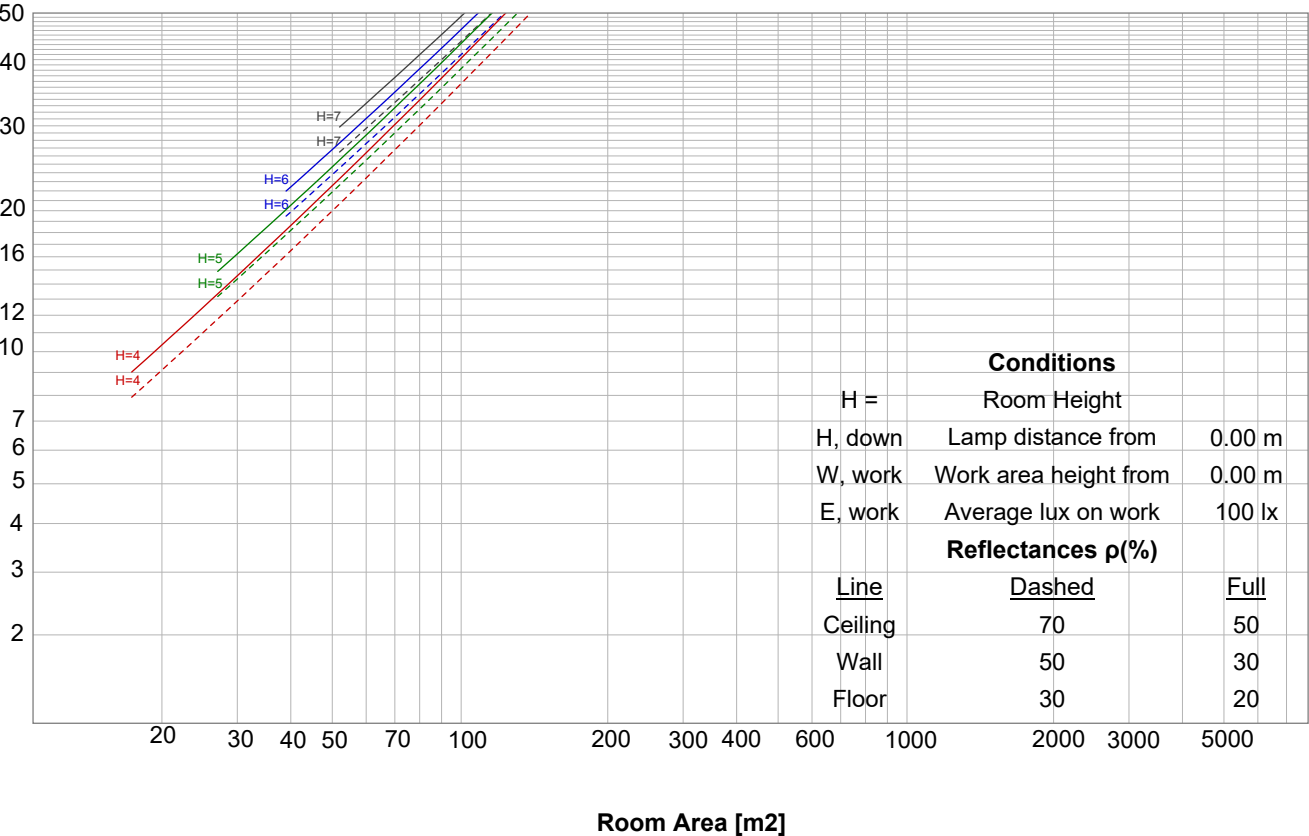

Test report

Print date 6/18/2026
Light measurement results



Intensity details

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3.3	6.6	9.8	13.1	16.4	19.7	23	26.2	29.5	32.8	36.1	39.4	42.7	45.9	49.2	52.5	55.8	59.1	62.3	65.6	ft
647	162	72	40	26	18	13	10	8	6	5	4	4	3	3	3	2	2	2	2	lux
60.1	15	6.7	3.8	2.4	1.7	1.2	0.9	0.7	0.6	0.5	0.4	0.4	0.3	0.3	0.2	0.2	0.2	0.2	0.2	fc

Intensities in 0° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
647	633	590	522	437	345	259	185	127	85	56	38	27	20	15	12	10	9	8	7	cd
100%	98%	91%	81%	67%	53%	40%	29%	20%	13%	9%	6%	4%	3%	2%	2%	2%	1%	1%	1%	of 0°val

Intensities in 90° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
647	646	640	630	618	604	589	573	557	538	517	495	473	450	426	400	372	341	310	279	cd
100%	100%	99%	97%	96%	93%	91%	89%	86%	83%	80%	77%	73%	69%	66%	62%	57%	53%	48%	43%	of 0°val

Intensities in 180° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
647	633	590	522	437	345	259	185	127	85	56	38	27	20	15	12	10	9	8	7	cd
100%	98%	91%	81%	67%	53%	40%	29%	20%	13%	9%	6%	4%	3%	2%	2%	2%	1%	1%	1%	of 0°val

Intensities in 270° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
647	646	640	630	618	604	589	573	557	538	517	495	473	450	426	400	372	341	310	279	cd
100%	100%	99%	97%	96%	93%	91%	89%	86%	83%	80%	77%	73%	69%	66%	62%	57%	53%	48%	43%	of 0°val

Test report

Print date 6/18/2026
Light measurement results



IESNA TM-15-07 LUMINAIARE CLASSIFICATION SYSTEM FOR OUTDOOR

Forward Light

Low (0-30°)	104.3	lm	34.6%
Medium (30-60°)	45.1	lm	14.9%
High (60-80°)	1.1	lm	0.4%
Very High (80-90°)	0	lm	0%

Back Light

Low (0-30°)	104.3	lm	34.6%
Medium (30-60°)	45.1	lm	14.9%
High (60-80°)	1.1	lm	0.4%
Very High (80-90°)	0	lm	0%


Uplight

Low (90-100°)	0	lm	0%
High (100-180°)	0.7	lm	0.2%

Total

Sum	301.6	lm	100%
------------	--------------	-----------	-------------

BUG RATING B0 U1 G0

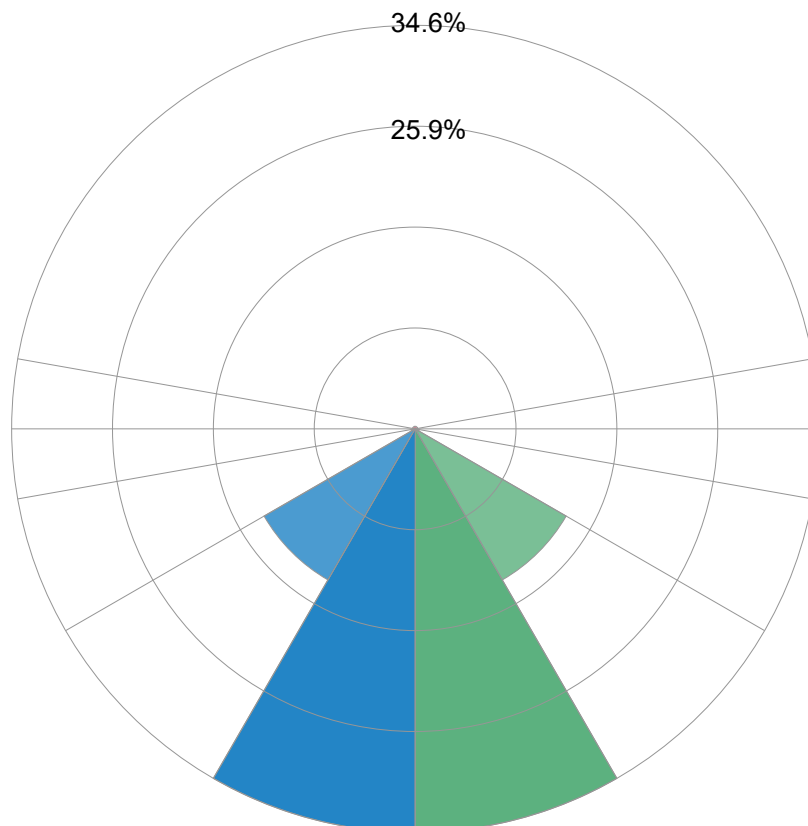

Test report

Print date 6/18/2026
Light measurement results



UGR Table

Corrected, comprehensive UGR table according to 117-1995, S/H ratio=0.25

Reflectances		ρ Ceiling	70	70	50	50	30	70	70	50	50	30
		ρ Walls	50	30	50	30	30	50	30	50	30	30
		ρ Floor	20	20	20	20	20	20	20	20	20	20
Room size			Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level			(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y											
2H	2H	-2.0	-1.4	-1.9	-1.1	-0.9	16.4	17.1	16.5	17.3	17.5	
	3H	-2.3	-1.5	-1.9	-1.3	-1.1	16.1	16.9	16.5	17.1	17.3	
	4H	-2.4	-1.6	-2.0	-1.4	-1.1	16.0	16.8	16.4	17.0	17.3	
	6H	-2.4	-1.7	-2.1	-1.4	-1.1	16.0	16.6	16.3	16.9	17.3	
	8H	-2.4	-1.8	-2.1	-1.5	-1.1	16.0	16.6	16.3	16.9	17.3	
	12H	-2.5	-1.9	-2.1	-1.5	-1.1	15.9	16.5	16.3	16.9	17.3	
4H	2H	-1.5	-0.8	-1.1	-0.5	-0.3	16.0	16.8	16.4	17.0	17.2	
	3H	-1.6	-1.0	-1.2	-0.6	-0.2	15.9	16.5	16.3	16.9	17.3	
	4H	-1.7	-1.2	-1.3	-0.8	-0.2	15.8	16.3	16.2	16.7	17.3	
	6H	-1.8	-1.2	-1.3	-0.9	-0.5	15.7	16.3	16.2	16.6	17.0	
	8H	-1.9	-1.3	-1.3	-1.0	-0.6	15.7	16.2	16.2	16.5	16.9	
	12H	-1.9	-1.5	-1.4	-1.1	-0.6	15.6	16.0	16.1	16.4	16.9	
8H	4H	-1.8	-1.3	-1.3	-1.0	-0.6	15.7	16.2	16.2	16.5	16.9	
	6H	-1.9	-1.6	-1.4	-1.1	-0.6	15.6	15.9	16.1	16.4	16.9	
	8H	-1.9	-1.6	-1.4	-1.1	-0.5	15.6	15.8	16.1	16.4	17.0	
	12H	-2.0	-1.8	-1.4	-1.2	-0.6	15.5	15.7	16.1	16.3	16.9	
12H	4H	-1.9	-1.5	-1.4	-1.1	-0.6	15.6	16.0	16.1	16.4	16.9	
	6H	-1.9	-1.6	-1.4	-1.1	-0.5	15.6	15.8	16.1	16.4	17.0	
	8H	-2.0	-1.8	-1.4	-1.2	-0.6	15.5	15.7	16.1	16.3	16.9	
Variations with the observer position for the luminaire spacings, S:												
S = 1.0H			2.4 / -2.5					2.9 / -6.2				
S = 1.5H			4.3 / -6.1					5.6 / -14.4				
S = 2.0H			5.6 / -18.5					7.6 / -29.3				

Coefficients of utilization

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20
RCR	(Room Cavity Ratio)				Room values are expressed as percentage of Lumen delivered to the task surface													
0	119.0	119.0	119.0	119.0	116.2	116.2	116.2	116.2	111.0	111.0	111.0	106.2	106.2	106.2	101.8	101.8	101.8	99.8
1	113.5	110.7	108.3	106.0	111.0	108.6	106.3	104.3	104.5	102.7	101.1	100.7	99.3	98.0	97.3	96.2	95.2	93.4
2	107.9	103.0	99.0	95.6	105.6	101.3	97.6	94.5	98.0	95.0	92.4	95.0	92.5	90.4	92.2	90.2	88.5	86.8
3	102.5	96.1	91.1	87.2	100.4	94.7	90.1	86.4	92.0	88.2	85.0	89.6	86.4	83.7	87.3	84.6	82.4	80.8
4	97.4	89.9	84.4	80.2	95.5	88.7	83.6	79.7	86.5	82.2	78.7	84.5	80.8	77.8	82.6	79.5	76.9	75.3
5	92.6	84.3	78.6	74.3	91.0	83.4	78.0	74.0	81.6	76.9	73.3	79.9	75.8	72.6	78.3	74.8	72.0	70.5
6	88.2	79.4	73.5	69.3	86.7	78.6	73.1	69.0	77.1	72.2	68.5	75.7	71.4	68.1	74.3	70.6	67.6	66.2
7	84.1	75.0	69.1	65.0	82.7	74.3	68.7	64.8	73.0	68.0	64.4	71.8	67.4	64.1	70.7	66.7	63.7	62.3
8	80.3	71.0	65.2	61.2	79.1	70.4	64.9	61.0	69.3	64.3	60.8	68.3	63.8	60.5	67.3	63.3	60.2	58.9
9	76.8	67.4	61.7	57.8	75.7	67.0	61.5	57.7	66.0	61.0	57.5	65.1	60.6	57.3	64.3	60.1	57.1	55.8
10	73.6	64.2	58.6	54.9	72.6	63.8	58.4	54.8	63.0	58.0	54.6	62.2	57.7	54.5	61.5	57.3	54.3	53.1

Test report

Print date 6/18/2026
Light measurement results




Power details

Input power

Frequency of input power	0 Hz
Power feed to light source	4.8 W
RMS Input voltage feed V,RMS	24.0 V
RMS Input current feed I,RMS	0.201 A
Volt-Amp or apparent power =	4.82 VA
Displacement factor of AC power feed	0.0
Power factor of AC current feed	1.0
Total harmonic distortion of the current	0%
Total harmonic distortion of the voltage	0%

Input power curve



Efficiency

Radiated power efficiency 21.5%

Lumen efficiency 63 lm/W

Stabilization details

Warmup Conditions

Stable period	3 min
Stable change max	500.0%
Minimum time	3 min

Color Temperature Change

CCT start	3036 K
CCT shift	-1 K
CCT end	3035 K


Warmup Result

Total warmup time	Lamp stabilized in 3
Warmup variation	-0.2%

Output Change

Output start	302 lm
Output change	lm
Output end	302 lm

Stabilization Curve

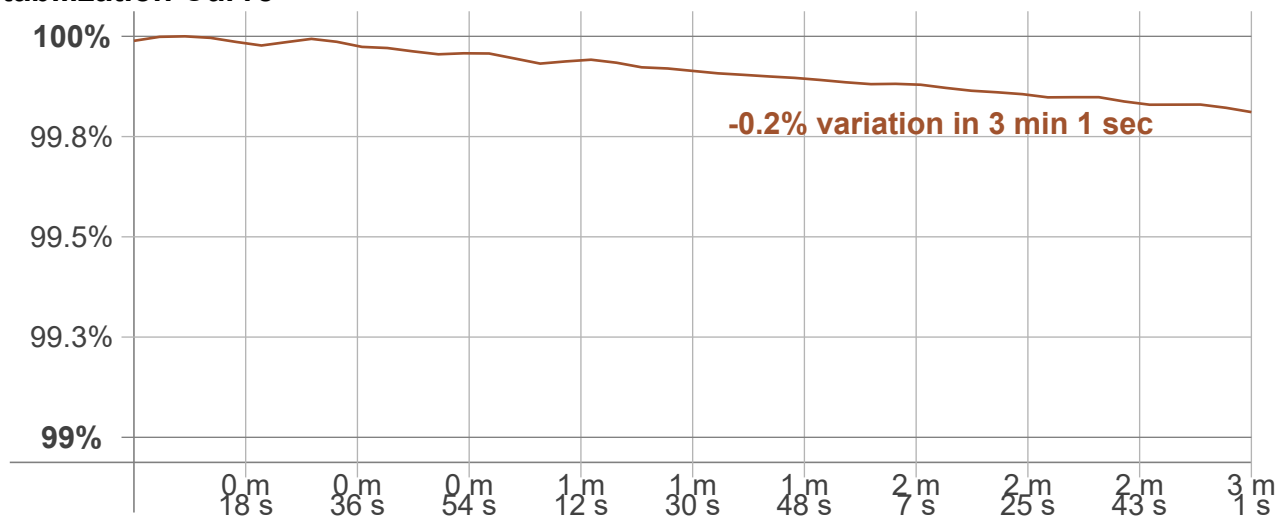

Test report

Print date 6/18/2026
Light measurement results



Flicker TLA details

Flicker Meter Type	Viso Systems LabFlicker
Frequency of input power	0 Hz
Flicker/TLA sample rate	n/a samples/s

Measurement time	
PstLM	180 sec.
All other indices	1,5 sec,

Flicker indices according to Illuminating Engineering Society

Flicker frequency	n/a Hz
Percent Flicker	n/a %
Flicker index	n/a

Flicker indices according to California Energy Commission (CEC)

JA8/10 40 Hz	n/a %
JA8/10 90 Hz	n/a %
JA8/10 200 Hz	n/a %
JA8/10 400 Hz	n/a %
JA8/10 1000 Hz	n/a %


TLA indices (re IEC TR 61547-1, IEC 61000-3-3 and IEC

PstLM value ($F < 80$ Hz)	n/a
SVM value ($80 < F < 2000$ Hz)	n/a


Flicker indices according to Lighting Research Center (2015)

Perception metric, Assist Mp	n/a
------------------------------	-----

Flicker frame (frame of one flicker period in time domain)

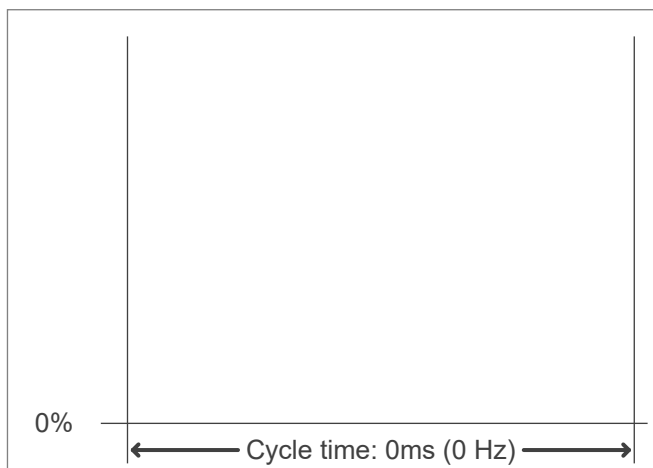

Flicker FFT (flicker curve in frequency domain)

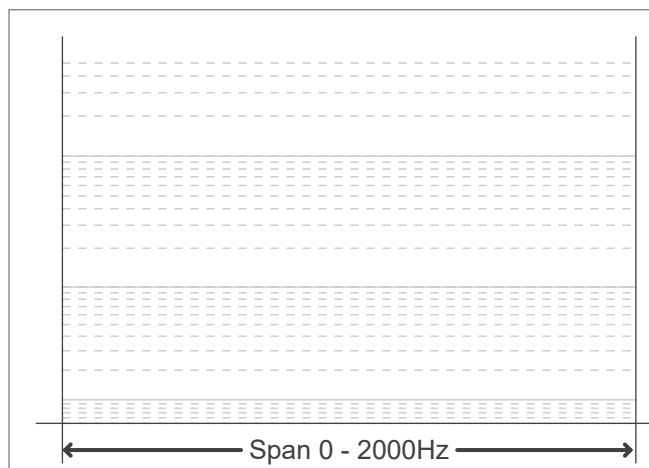

IEEE 1789 Frequency/modulation plot

